

PERFORMANCE TESTS IN ACCORDANCE WITH  
AAMA/WDMA/CSA 101/I.S.2/A440-08




**Report No.:**  
**AI-03810-I1**

**Product Manufacturer:**

PH TECH INC.  
8650 DE LA RIVE-SUD BLVD.  
LÉVIS, QUEBEC  
G6V 6N8  
418-833-3231

**Test Report Summary:**

Product type: PVC Horizontal Sliding Window  
Product series/model: S-3725/ S-3735 Series Single Slider (Boreal sash)  
Without reinforcement and with sill adaptor 5825



Primary product designator: **Class R-PG50-HS Size tested 1600 x 1100 (63 x 43)**


Optional secondary designator: Positive Design pressure (DP) = 2640 Pa (55.0 psf)  
Negative design pressure (DP) = -2640 Pa (-55.0 psf)  
Water penetration resistance test pressure = 360 Pa (7.50 psf)  
Canadian air infiltration / exfiltration level = A3 Level

Test completion date: 11/04/2011  
Report date: 11/17/2011  
Revision date: -  
Number of pages: 8

CAN/CSA A440-00 ratings: A3/F/B3/C4/F20/S1

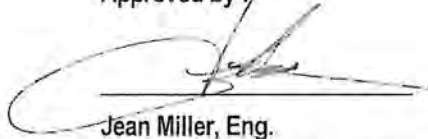
Note: Reference must be made to Air-Ins Inc. complete report for test specimen description and detailed test results.

Prepared by :

  
Jason Michaud, Tech.

Physical Testing Department  
Air-Ins Inc.

Approved by :

  
Jean Miller, Eng.

Director, Physical Testing Department  
Air-Ins Inc.

 **AIR-INS inc.**  
1320, boul. Lionel-Boulet,  
Varenes (Québec) J3X 1P7  
☎ (450) 652-0838  
☎ (450) 652-7588  
✉ info@air-ins.com



**5.0 RESULTS OF PERFORMANCE TESTS**

**5.1 TEST SPECIMEN PRIMARY TESTING**

TEST	<div style="border: 1px solid black; padding: 5px; display: inline-block; font-size: 2em; font-weight: bold; margin-right: 10px;">R</div> CLASS SPECIFICATIONS	TEST RESULTS	GRADE OR COMMENT
Operating Force Test	<u>U.S. (only) requirements:</u> Force to initiate motion: Reported only Force to maintain motion < 90 N (20 lbf) Force to latch < 100 N (22.5 lbf) <u>Canadian (only) requirements:</u> Force to initiate motion: (normal use) < 90 N (20 lbf) (cleaning/maintenance) < 180 N (40 lbf) Force to maintain motion: (normal use) < 45 N (10 lbf) (cleaning/maintenance) < 115 N (25 lbf) Force to latch < 100 N (22.5 lbf) AAMA/WDMA/CSA 101/1.S.2/A440-08 par. 5.3.1.1 & ASTM-E2068-00 (2008)	Measured to initiate = 76 N (17 lbf) Measured to maintain = 44 N (10 lbf) Measured to latch = 2 N (0.5 lbf)  *With silicone spray lubricant	Passed
Air Leakage Resistance Test	$Q_{inf} \leq 1.5 \text{ l/s-m}^2 @ 75 \text{ Pa}$ $(\leq 0.3 \text{ cfm/ft}^2 @ 1.57 \text{ psf})$ AAMA/WDMA/CSA 101/1.S.2/A440-08 par. 5.3.2.1 & ASTM-E283-04	Surface: 1.76 m <sup>2</sup> (18.95 ft <sup>2</sup> ) $Q_{inf} = 0.17 \text{ l/s-m}^2 @ 75 \text{ Pa}$ $(0.03 \text{ cfm/ft}^2 @ 1.57 \text{ psf})$	Passed
	<u>Canadian air infiltration/exfiltration level:</u> A2: $Q_{inf \& \text{exf}} \leq 1.5 \text{ l/s-m}^2 @ 75 \text{ Pa}$ $(\leq 0.3 \text{ cfm/ft}^2 @ 1.57 \text{ psf})$ A3: $Q_{inf \& \text{exf}} \leq 0.5 \text{ l/s-m}^2 @ 75 \text{ Pa}$ $(\leq 0.1 \text{ cfm/ft}^2 @ 1.57 \text{ psf})$ AAMA/WDMA/CSA 101/1.S.2/A440-08 par. 5.3.2.2 & ASTM-E283-04	$Q_{inf} = 0.17 \text{ l/s-m}^2 @ 75 \text{ Pa}$ $(0.03 \text{ cfm/ft}^2 @ 1.57 \text{ psf})$ $Q_{exf} = 0.22 \text{ l/s-m}^2 @ 75 \text{ Pa}$ $(0.04 \text{ cfm/ft}^2 @ 1.57 \text{ psf})$ $Q_{avg} = 0.19 \text{ l/s-m}^2 @ 75 \text{ Pa}$ $(0.04 \text{ cfm/ft}^2 @ 1.57 \text{ psf})$	A3 level
Water Resistance Test	No water infiltration under a minimum pressure differential of 140 Pa (2.90 psf) AAMA/WDMA/CSA 101/1.S.2/A440-08 par. 5.3.3.2 & ASTM-E547-00 (2009)	No water infiltration under a pressure differential of 360 Pa (7.50 psf) with and without insect screen.	50
Uniform Load Deflection Test	Deflection at 720 Pa (15.00 psf) minimum class level and at optional Design Pressure (DP) performance level.  AAMA/WDMA/CSA 101/1.S.2/A440-08 par. 5.3.4.2 & ASTM-E330-02 (2010)	Net deflection measured on the meeting stile: 2.92 mm @ -720 Pa (0.11 " @ -15.00 psf) 2.90 mm @ +720 Pa (0.11 " @ +15.00 psf) 13.70 mm @ -2640 Pa (0.54 " @ -55.00 psf) 13.55 mm @ +2640 Pa (0.53 " @ +55.00 psf)  Net deflection measured on the upper rail: 0.42 mm @ -720 Pa (0.02 " @ -15.00 psf) 1.59 mm @ +720 Pa (0.06 " @ +15.00 psf) 0.72 mm @ -2640 Pa (0.03 " @ -55.00 psf) 7.26 mm @ +2640 Pa (0.29 " @ +55.00 psf)  Allowed: Not applicable for this performance class	Reported only

Performance Evaluation: S-3725 / S-3735 Series PVC Single Slider Window (without reinforcement and with sill adaptor 5825)



<p><b>Uniform Load Structural Test</b></p>	<p>Permanent deformation <math>\leq 0.4\%</math> of the member span at minimum class level of 1080 Pa (22.5 psf) and at optional Structural Test Pressure (STP) levels. <i>AAMA/WDMA/CSA 101/I.S.2/A440-08 par. 5.3.4.3 &amp; ASTM-E330-02 (2010)</i></p>	<p>Permanent deformation measured on the meeting stile: 0.31 mm @ -1080 Pa (0.01 " @ -22.50 psf) 0.30 mm @ +1080 Pa (0.01 " @ +22.50 psf) 1.16 mm @ -3960 Pa (0.05 " @ -82.50 psf) 0.05 mm @ +3960 Pa (0.00 " @ +82.50 psf) Allowed <math>\leq 3.92</math> mm (0.15 ")</p> <p>Permanent deformation measured on the upper rail: 0.10 mm @ -1080 Pa (0.00 " @ -22.50 psf) 0.17 mm @ +1080 Pa (0.01 " @ +22.50 psf) 0.05 mm @ -3960 Pa (0.00 " @ -82.50 psf) 0.12 mm @ +3960 Pa (0.00 " @ +82.50 psf) Allowed <math>\leq 2.96</math> mm (0.12 ")</p>	<p>55</p>
<p><b>Forced-Entry Resistance Test</b></p>	<p>All windows shall be tested according to ASTM F588-07 performance level 10. <i>AAMA/WDMA/CSA 101/I.S.2/A440-08 par. 5.3.5</i></p>	<p>Grade 40 of ASTM F588-07 <math>T_1=10</math> min., <math>L_1=1334</math> N (300 lbf), <math>L_2=667</math> N (150 lbf) &amp; <math>L_3=267</math> N (60 lbf)</p>	<p>Passed</p>

**5.2 TEST SPECIMEN AUXILIARY TESTING**

TEST	<div style="border: 1px solid black; padding: 5px; display: inline-block; font-size: 2em; font-weight: bold; margin-right: 10px;">R</div> CLASS SPECIFICATIONS	TEST RESULTS	GRADE OR COMMENT
<p><b>Welded Corner Test</b></p>	<p>When loaded to failure, the break shall not extend along the entire weld line. <i>AAMA/WDMA/CSA 101/I.S.2/A440-08 par. 5.3.6.2</i></p>	<p>For each corner detail (sash and frame) the breakage does not extend along the entire weld line.</p>	<p>Passed</p>
<p><b>Deglazing Test</b></p>	<p>Deglazing <math>&lt; 90\%</math> of original glazing bite. The load for vertical sash members is 320 N (70 lbf) and 230 N (50 lbf) for all other rails. <i>AAMA/WDMA/CSA 101/I.S.2/A440-08 par. 5.3.6.3 &amp; ASTM E987-88 (2009)</i></p>	<p>Allowed: 13.56 mm (0.53")/ 90 % Measured: 0.70 mm (0.04") / 4.6 % for stiles Measured: 0.22 mm (0.01")/ 1.5% for rails</p>	<p>Passed</p>
<p><b>Insect Screen Test</b></p>	<p><u>Canadian (only) requirements:</u> Insect screens shall be tested in accordance with ASTM E1748 in the outward direction only under a load of 60 N (13 lbf). <i>A440S1-09 Canadian Supplement to AAMA/WDMA/CSA 101/I.S.2/A440 par. 5.1</i></p>	<p>No screen disengagement or permanent deformation under a 60 N (13 lbf) load.</p>	<p>Passed</p>

Performance Evaluation: S-3725 / S-3735 Series PVC Single Slider Window (without reinforcement and with sill adaptor 5825)



**6.0 CONCLUSION**

Based on the tests results, the window described in this report meets the requirements of the AAMA/WDMA/CSA 101/I.S. 2/A440-08 Standard regarding performance testing (article 5.0).

Detailed assembly drawings showing wall thickness of all members, corner construction and hardware application are on file and have been compared to the sample submitted.

The above results were secured by using the designated test methods and they indicate compliance with the performance requirements of the referenced specification. The test records from this evaluation will be retained for a minimum of four (4) years from the date of report issuance. This report does not constitute certification of this product, which may only be granted by a certification agency.

Note on the Limitation of Liability:

*Due care was taken in performing the testing sequence and in reporting the results related to the test specimen received for evaluation. Through acceptance of this report, the Client agrees to exempt Air-Ins Inc. employees and owners from all liability claims and demands arising from any matter related to or concerning the quality and execution of the performance evaluation contained in this report.*

**7.0 REVISION LOG**

Rev. #	Date	Page(s)	Revision(s)